



INSTALLATION, SERVICE AND MAINTENANCE INSTRUCTION

***2-way solenoid valve for heating gas
direct acting - Normally closed (NC)***

***Type: 2 VE 6 FG
2 VE 6 FGJ***

***2-way solenoid valve for heating gas
direct acting - Normally open (NO)***

***Type: 2 VE 6 IFG
2 VE 6 IFGJ***


REGADA, s. r. o., Strojnícka 7
080 01 Prešov, Slovenská republika
Tel.: +421-51-7480 465, 7480 464
Fax: +421-51-7480 466
E-mail: regada@regada.sk
Web: www.regada.sk

2-way solenoid valves for heating gas - direct acting, Normally closed (NC) - direct acting, Normally open (NO)

Application

Two-way (2/2) solenoid valves direct acting can be used for flow control of heating gas and other non-aggressive medium suitable for applied materials. Valves are closed or open at the basic position without voltage. After bringing of voltage to the coil the valve is open or closed according function.

2-way solenoid valves normally closed- technical data according TP 75 0361/03




Type	Connection	Flow ¹⁾ Factor Kv [m ³ /h]	Operating pressure [kPa]		Voltage / Power consumption	Medium tempera- ture [°C]	Ambient temperature [°C]	Weight [kg]
			min	max.				
2VE6FG	G 1/4	0,55	0	50	AC / 15 VA	0 ÷ +60	0 ÷ +50	0,36
2VE6FGJ		0,46		50	DC / 10 W			

Valves are classification in classes A, group of 1 according EN 161+A3. Period opening and close-up < 1 s.

¹⁾ Flow is appointed for inlet pressure (max. operating pressure) and loss of pressure $\Delta p=2,5\text{mbar}$ (1kPa=10mbar)

2-way solenoid valves normally open - technical data according TP 75 0361/03



Type	Connection	Flow ¹⁾ Factor Kv [m ³ /h]	Operating pressure [kPa]		Voltage / Power consumption	Medium tempera- ture [°C]	Ambient temperature [°C]	Weight [kg]
			min	max.				
2VE6IFG	G1/4	0,42	0	50	AC / 15 VA	0 ÷ +60	0 ÷ +50	0,4
2VE6IFGJ					DC / 10 W			

Valves are classification in classes A, group of 1 according EN 161+A3. Period opening and close-up < 1 s.

¹⁾ Flow is appointed for inlet pressure (max. operating pressure) and loss of pressure $\Delta p=2,5\text{mbar}$ (1kPa=10mbar)

Applied materials

Body.....brass
 Internal partsstainless steel, brass
 Seals.....FPM (Viton)
 Coil Regada, type 24 1241 xx, System 13-32, thermal class F(H)
 Degree of protection according to EN 60529.....IP 65

Ports

1 - Inlet
 2 - Outlet

Installation

Clean thoroughly pipeline system before valve installing. Dirt causes malfunction. Necessary fit filter with 0, 2 mm filtration softness of valve inlet. The valve will not open or close if the control ducts or the armature are blocked by dirt. Electromagnet may not be used to capture the torque when fitting into the pipe.

Operating position of valve is optional. Preferentially recommended is mounting with coil over the body to horizontal pipeline.

Controlled medium has to flow through in direction of arrow as marked on the body. Valve is running correctly only in marked flow direction.

The valve has in bottom body part two threaded openings M4 for potential assembly to the equipment.

Electrical connection

Connect the coil in accordance with National electrical Engineering Standards. Before coil connection check electric data on coil and mains voltage. Voltage is connected to terminals marked on terminal board. Protective conductor must be safely connected to protective terminal, which is marked on the terminal board. The electrical cable must be effectively sealed in a plug. Electric connector plug provides protection for coil IP 65.

Coil is mounted to valve rotated in 360°. The plug can be positioned on the coil by 4 x 90°.

Voltage can be connected to the coil only when assembled on the valve, the coil for alternating power can be damaged during connection, if is not slipped on the core guide !!!!!

Instruction for operation

Operating conditions should correspond with valve technical data. Temperature and medium type should correspond with seals and material of valve. By valve running is it necessary to check function rightness, seals and joints tightness.

Frozen medium causes a damage of valve and coil. Valves are not frost-proof. In case that medium freezes valve shall not be switch on because of possibility to coil damage.

Maintenance

Maintenance is necessary in case of valve failure only (no function rightness, no tightness). Preventive maintenance is advised in case of worse operating conditions, often initializing of valve or by medium pollution.

Maintenance work must be carried out only by the absence of pressure in the pipeline and with solenoid disconnected from the voltage supply.

After valve repair or replacing test the valve with 1,5 multiple of maximum operating pressure. Valve should be not initializing by testing, valve could be opened or closed by testing.

Upon request, manufacturer is able to supply some kinds of spare parts and brochures with sectional drawing and assembly instructions. By coil ordering is it necessary to set number and kind of voltage (AC or DC).

Guarantee and Service

The manufacturer is responsible for the solenoid valve properties during 12 months since delivery. In case of any claim it is required to present the solenoid valve, a document about buying (payment receipt) and these Installation, Service and Maintenance Instructions. The guarantee is not approved if the damages are caused by inappropriate impact to the regulator or with not following these Instructions.


Under-and out-of –guarantee repairs can be performed by the manufactures.


Product liquidation

Components and pack can be used as source of secondary raw material.

Product is not source of environmental pollution and doesn't include danger scrap.

Valve measurements 2VE6FG, 2VE6FGJ

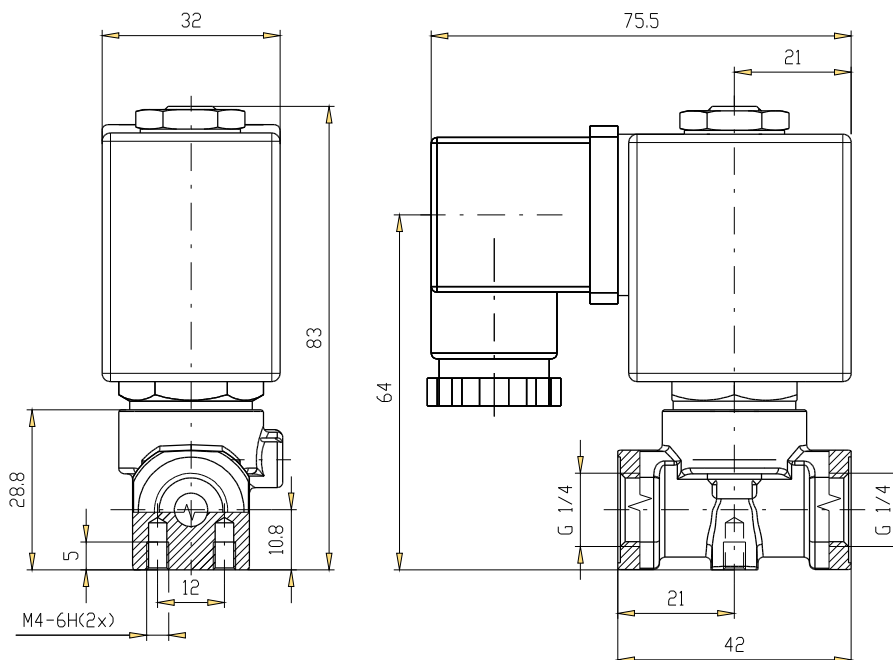


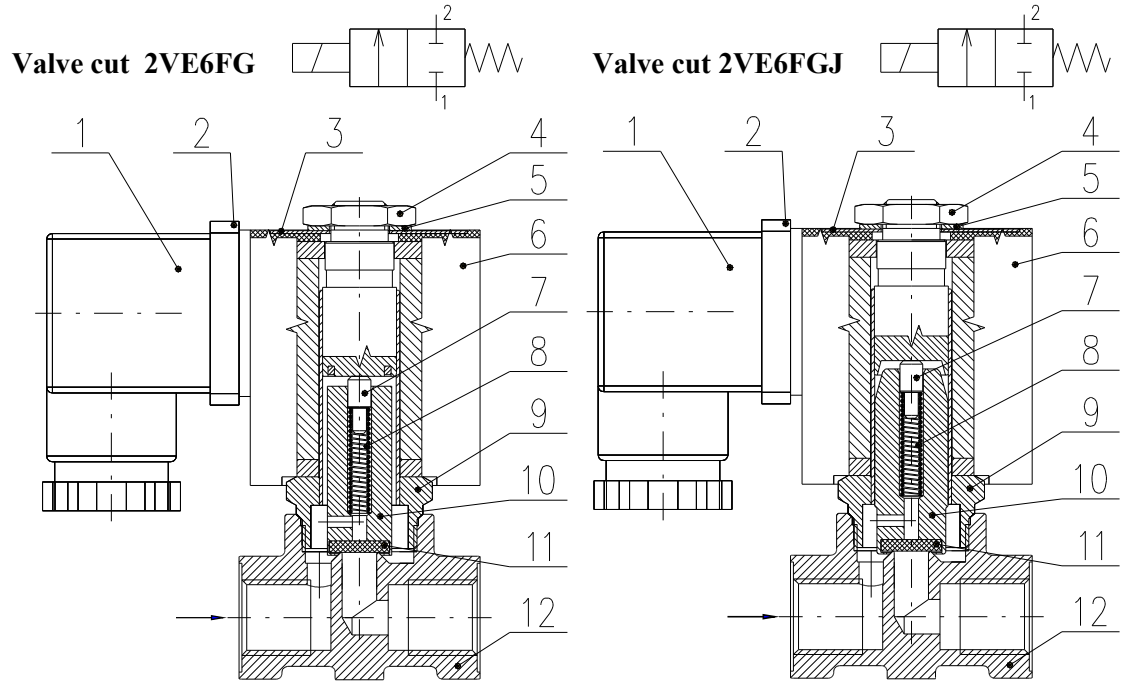

Legend

- 1 – Connector
- 2 – Seal connector
- 3 – Type label
- 4 – Nut
- 5 – Washer
- 6 – Coil
- 7 – Peg
- 8 – Spring
- 9 – Armature guide
- 10 – Core
- 11 – Seal
- 12 – Body

Valve cut and measurements 2VE6IFG, 2VE6IFGJ

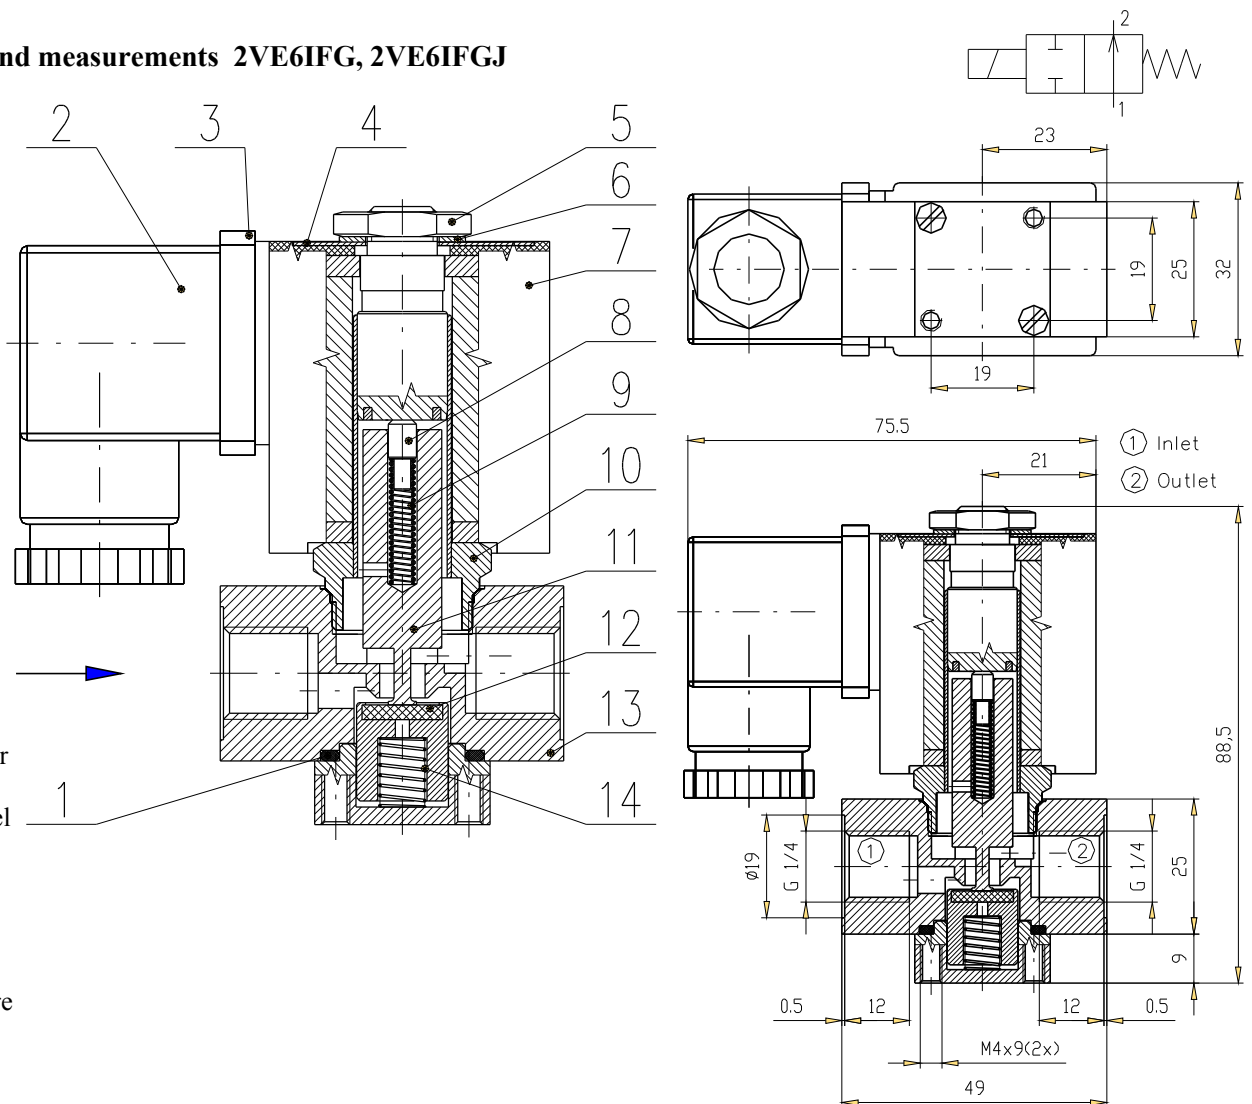

Legend

- 1 – Seal
- 2 – Connector
- 3 – Seal
- 4 – Type label
- 5 – Nut
- 6 – Washer
- 7 – Coil
- 8 – Peg
- 9 – Spring
- 10 – Armature guide
- 11 – Core
- 12 – Seal
- 13 – Body
- 14 – Spring